


PLANO: ALCANTARILLADO PROYECTADO  
ESC.: 1/500

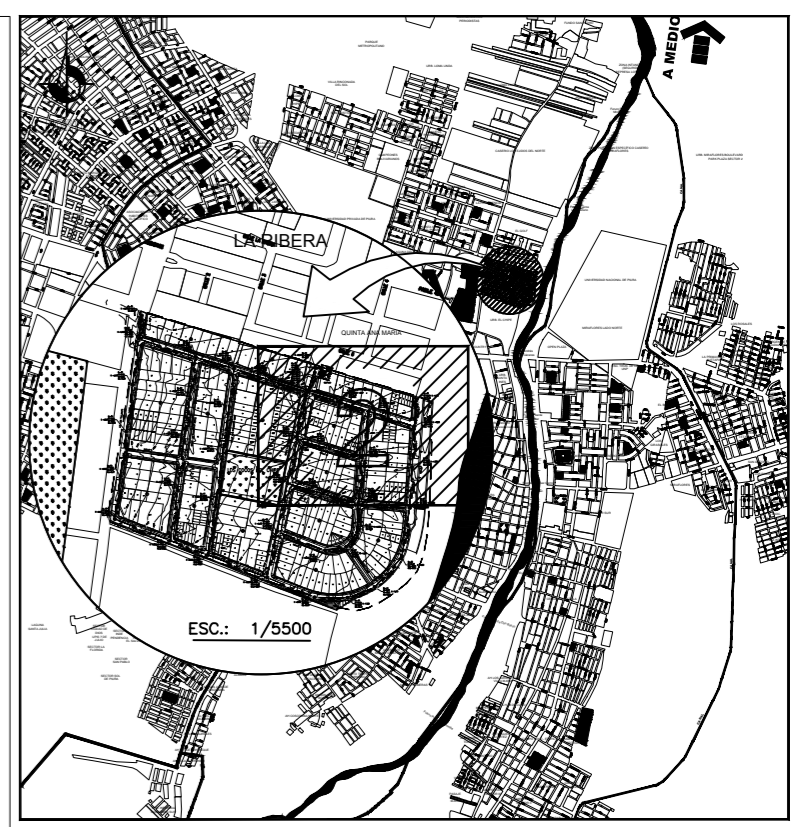

PLANO UBICACIÓN  
ESC.: 1/50 000


METRADO DE TUBERÍAS

TUBERÍA	Diámetro	Long. de tubería (ml)
PVC / UF NTP ISO 4435/21138 SN-4	200 mm	2,292.12
PVC / UF NTP ISO 4435/21138 SN-4	250 mm	539.06
PVC / UF NTP ISO 4435/21138 SN-4	315 mm	305.66
PVC / UF NTP ISO 4435/21138 SN-8	315 mm	46.52
<b>Totales</b>		<b>3183.36</b>

CLASIFICACIÓN DE BUZONES POR RANGO DE PROFUNDIDAD

H-DESDE	1.00	1.51	2.01	2.51	3.01	3.51	4.01	5.01	6.01	TOTAL
H-HASTA	1.50	2.00	2.50	3.00	3.50	4.00	5.00	6.00	7.00	
C.C.	7	12	10	3	3	3	2	0	0	40

ESCALA GRÁFICA

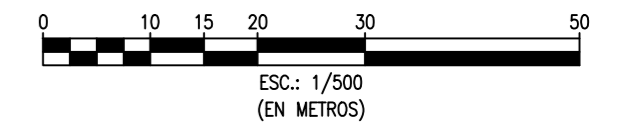

LUGAR: URBANIZACIÓN LOS COCOS DEL CHIPE	DISTRITO : PIURA	CONSULTOR: -----	ELABORO : A.M.R.D	APROBO : -----	REVISIONES: REV. N°: FECHA: -----	PROYECTO: REHABILITACION DE REDES DE AGUA POTABLE Y ALCANTARILLADO LOS COCOS DEL CHIPE - DISTRITO Y PROVINCIA DE PIURA -DEPARTAMENTO DE PIURA	PLANO : RED SECUNDARIA DE ALCANTARILLADO PROYECTADO	ESCALA : FECHA : MAYO 2019 PLANO N° : RED-AL LAMINA N° : 2 DE 4
--	---------------------	---------------------	----------------------	-------------------	--------------------------------------	--	--	---